

ADDENDUM#2
To
SPECIFICATIONS
AND
BID DOCUMENTS
FOR
SINGLE PHASE POLE MOUNTED TRANSFORMERS
FOR
CITY OF OAK RIDGE, TN

Document # 2012-1POLXFMR.addendum a xfmr id.docx Dated July 11, 2012

Issued by: Phil Stokinger
pstokinger@cortn.org
(865) 425-1864


Clarification: A-XFMR ID

Clarification of the high side voltage for Voltage Designations 11-18. The updated A-XFMR ID is attached. Please acknowledge receipt of this addendum when you submit your proposal.

**CITY OF OAK RIDGE
ELECTRIC DEPARTMENT
TRANSFORMER ITEM NUMBER IDENTIFIER**

7620 V L-N Primary		7620/13200Y V Primary	
VOLTAGE DESIGNATION	VOLTAGE	VOLTAGE DESIGNATION	VOLTAGE
01	120	11	120
02	108Y/120	12	208Y/120
03	120/240 or 240/120	13	120/240 or 240/120
04	240 or 240 Delta/120 MT	14	240 or 240 Delta/120 MT
05	240/480 or 480/240	15	240/480 or 480/240
06	277	16	277
07	480Y/277	17	480Y/277
08	480 Delta	18	480 Delta

Transformer Item Numbers are described as follows:

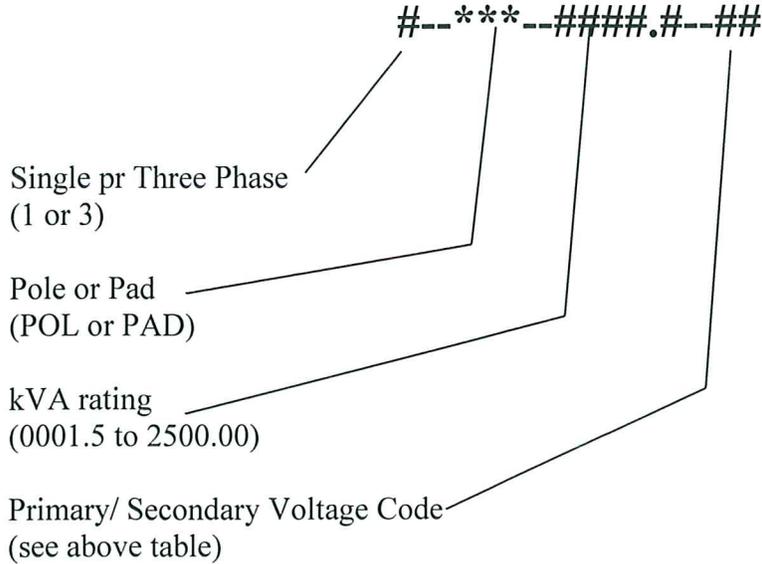

Example: 3-PAD-1000.0-17

This is a Three Phase, Pad-mounted transformer rated 1000 kVA, with a high voltage of 13,200/7620Y and a low voltage of 480Y/277