



PROJECT: 480 Volt Switchgear
Oak Ridge, Tennessee

ADDENDUM NO.: 1

ADDENDUM DATE: July 11, 2014

OWNER: City of Oak Ridge, TN
Electric Department
100 Woodbury Lane
Oak Ridge, Tennessee 37830

ENGINEER: Cannon & Cannon, Inc.
8550 Kingston Pike
Knoxville, Tennessee 37919

ALL BIDS SHALL CONFORM TO THIS ADDENDUM:

This addendum forms a part of the Contract referenced above. The following items covering changes in the bidding requirements shall apply to and become a part of the requirements thereof.

Receipt of this Addendum shall be acknowledged by inserting its number and date in the space on the Bid Proposal Form. Failure to do so may result in disqualification of the Bidder.

This Addendum consists of one (1) pages and the following attachments.

- Drawing

ITEM No. 1 SPECIFICATIONS

- A. Delete sections 2.2D, 2.2G, and 2.2H in their entirety.
- B. Delete the last sentence, "A door bellows system shall be placed around the front of each breaker to prevent arc gasses from escaping around the breaker escutcheon.

ITEM NO. 2 CLARIFICATIONS

The following items are clarifying comments on the overall intent of the Project.

- A. In general, the Project Scope is to provide three separate self-contained outdoor switchgear assemblies. Each of the assemblies is to contain a single 2500 amp frame breaker with the trip unit as specified on the Bid Form.


END ADDENDUM NO. 1

OAK RIDGE WWTP

EXISTING
13 KV TO 480 V
PAD MOUNT
TRANSFORMER

NEW NEMA 3R
SWITCH GEAR,
2500 AMP FRAME,
SINGLE BREAKER WITH
1200 AMP TRIP UNIT

EXISTING
PUMP STATION
SERVICE ENTRANCE
MAIN

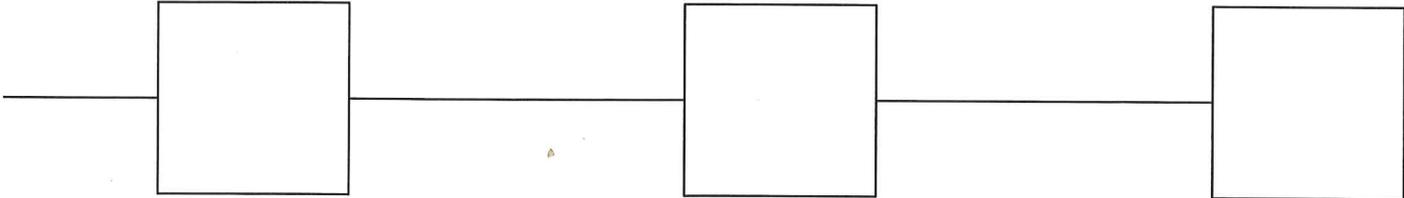


BIG TURTLE PUMP STATION

EXISTING
13 KV TO 480 V
PAD MOUNT
TRANSFORMER

NEW NEMA 3R
SWITCH GEAR,
2500 AMP FRAME,
SINGLE BREAKER WITH
1600 AMP TRIP UNIT

EXISTING
ADMIN BUILDING
SERVICE ENTRANCE
MAIN

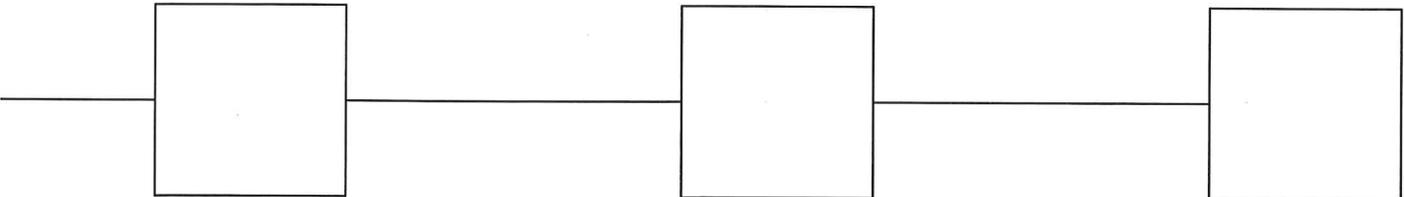


WWTP ADMIN. BUILDING

EXISTING
13 KV TO 480 V
PAD MOUNT
TRANSFORMER

NEW NEMA 3R
SWITCH GEAR,
2500 AMP FRAME,
SINGLE BREAKER WITH
2000 AMP TRIP UNIT

EXISTING
BLOWER FACILITY
SERVICE ENTRANCE
MAIN

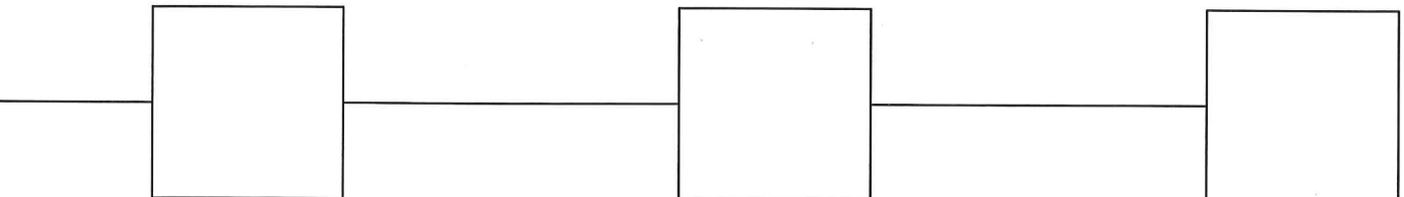

WWTP BLOWER FACILITY