



This certification form must be completed by a "City Certified" Grease Waste Hauler or Plumber.

GREASE INTERCEPTOR CERTIFICATION (Form A)
City of Oak Ridge, TN

Every food service establishment in the City of Oak Ridge must have their grease interceptor certified annually, to verify that all components of the grease control equipment are present and in good working condition. Furthermore, the certification will identify any structural problems with the grease interceptor. The completed original form must be submitted to the City of Oak Ridge.

Facility Name: _____ Phone #: _____

Address: _____ City: _____, TN. Zip Code _____

	<u>PASS</u>	<u>FAIL*</u>
1. Interceptor completely emptied and cleaned before inspection?	<input type="checkbox"/>	<input type="checkbox"/>

2. There is access to all interceptor chambers for cleaning and inspections?	<input type="checkbox"/>	<input type="checkbox"/>

3. Influent (inlet) T is attached and extends downward at least 2/3 depth of tank?	<input type="checkbox"/>	<input type="checkbox"/>

4. Effluent (outlet) T is attached and extends downward to within 12" of tank bottom?	<input type="checkbox"/>	<input type="checkbox"/>

5. Effluent (outlet) T is made of non-collapsible material that does <u>not</u> easily flex or bend (i.e. minimum- schedule 40 PVC, etc.), and is secure, not allowing fats, oils or grease to escape around edges?	<input type="checkbox"/>	<input type="checkbox"/>

6. Interceptor tank does <u>Not</u> have visible holes or leaks?	<input type="checkbox"/>	<input type="checkbox"/>

7. Mid-wall baffle(s) is secure and operational?	<input type="checkbox"/>	<input type="checkbox"/>

8. Interceptor maintaining structural integrity?	<input type="checkbox"/>	<input type="checkbox"/>

9. No Sewer clean-out covers missing or damaged?	<input type="checkbox"/>	<input type="checkbox"/>

*** IMPORTANT REQUIRED INFORMATION & RESPONSE:** If the answer to any of the above questions is "Fail", the equipment has failed certification. A statement of the plan of action to be taken, with date to be completed, must be provided on the other side of this form under "Response Comments" (attach additional sheets to explain corrective action if necessary):

Inspector Certification – This grease interceptor has PASSED FAILED certification.

I _____ of _____
(print name of inspector) (print company name)

certify that the above listed facility has an approximate _____ gallon capacity interceptor. I have examined the interceptor and provided the above information.

(signature) (date) (phone number)

Facility Owner/Manager Certification

I _____ certify to the best of my knowledge the above
(print name)

statements to be true and correct. _____
(signature) (date)

*SUBMIT COMPLETED **ORIGINAL** CERTIFICATION FORM TO:

City of Oak Ridge, Attn: FOG Program, P.O. Box 1, Oak Ridge, TN 37831


M
U
S
T

C
O
M
P
L
E
T
E

A
L
L

I
N
F
O
R
M
A
T
I
O
N

Grease Interceptor Diagram

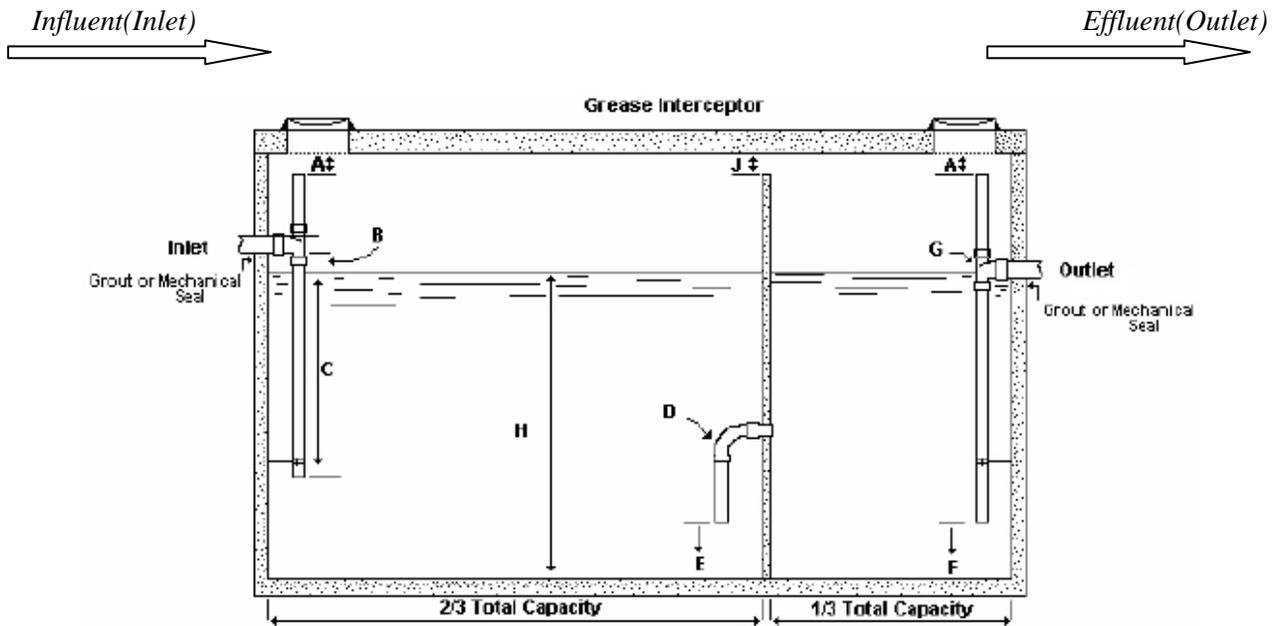

- A.) Minimum 6", but not less than pipe diameter.
- B.) Inlet pipe invert to be 2 1/2" above liquid surface.
- C.) Inlet pipe to terminate 2/3 depth of water level.
- D.) 90 degree Sweep, minimum size - 6".
- E.) 12" from floor to end of sweep.
- F.) 12" from floor to end of outlet pipe.
- G.) Outlet pipe no smaller than inlet pipe, minimum - 4".
- H.) Minimum depth of liquid capacity - 42".
- J.) Maximum distance from ceiling - 6".

RESPONSE COMMENTS (required if "Failed" checked, identify problem, corrective action and provide planned date of corrective action)
